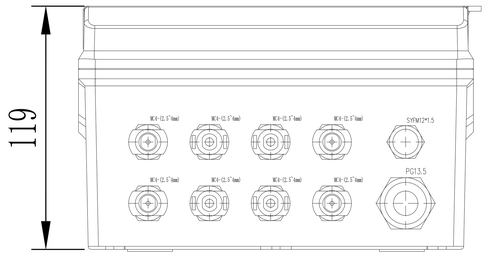


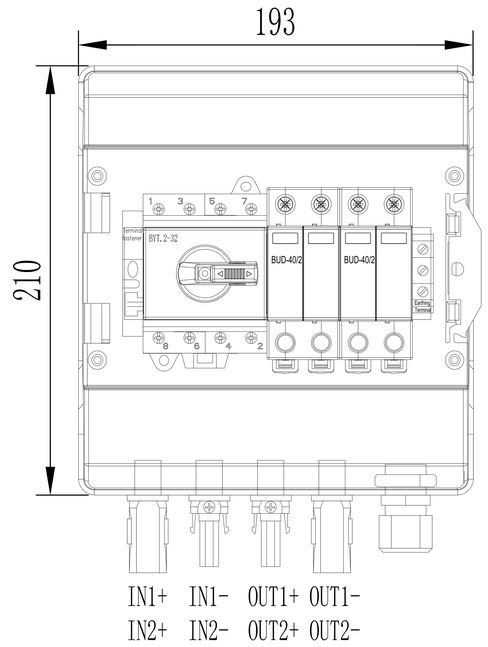


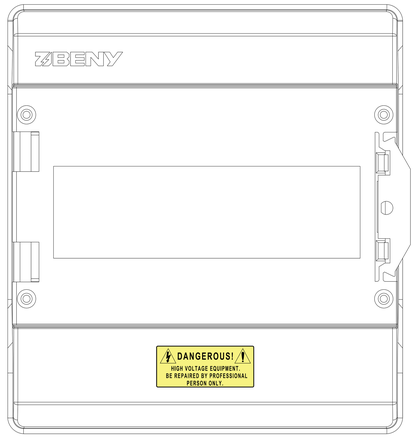


| number | label | The name of the | specifications | quantity | note |
|---|---|---|---|---|---|
| 3 | | Vent Valve | SYFM12*1.5 | 1 | |
| 2 | | CABLE GLAND | PG13.5 SEALING RANGE 6.7-12mm | 1 | |
| 1 | | CABLE GLAND | MC4 SEALING RANGE 2.5-4mm | 8 | |

| | | | | | |
|---|---|---|---|---|---|
| The contract no | | | | Tank no | Factory number |
| tag | Change the file no | The signature | The date of | BHS-2/2(DC600V,BYT.2 ) PV COMBINER BOX | Pattern marker / The proportion |
| design | | standardized | | Arrangement diagram | 浙江奔一电气有限公司 Zhejiang Benyi Electrical Co., Ltd. |
| drawing | | Review and approval | | | |
| check | | approval | | | |
| process | | The date of | | | |

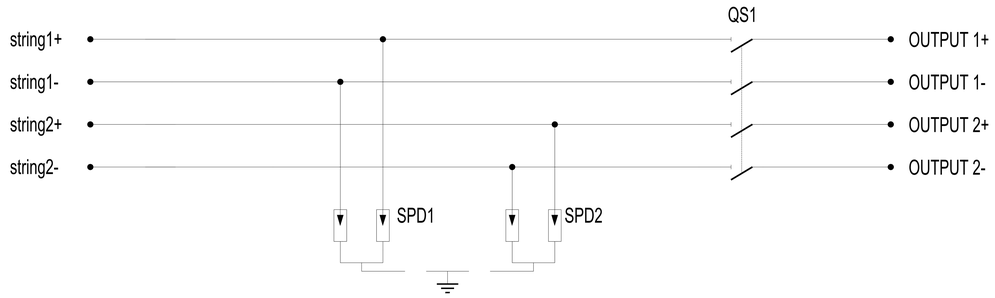


| number | label | The name of the | specifications | quantity | note |
|---|---|---|---|---|---|
| 2 | QS1 | DC Switch | BYT.2/4P 32A DC600V | 1 | |
| 1 | SPD1,SPD2 | DC SPD | BUD-40KA/2P DC600V | 2 | |

| | | | | | | | |
|---|---|---|---|---|---|---|---|
| The contract no | | | | | Tank no | | Factory number |
| tag | | Change the file no | The signature | The date of | BHS-2/2(DC600V,BYT.2) PV COMBINER BOX | | Pattern marker / The proportion |
| design | | standardized | | | Schematic diagram | | 浙江奔一电气有限公司 Zhejiang Benyi electric co., LTD |
| drawing | | Review and approval | | | | | |
| check | | approval | | | | | |
| process | | The date of | | | | | |